




Installation manual

R32 split series

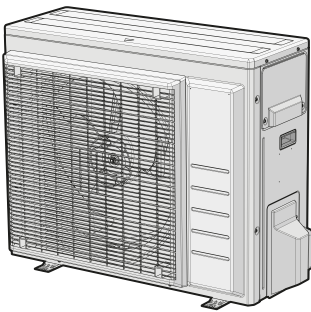

RXP50N5V1B
RXP60N5V1B
RXP71N5V1B

Installation manual
R32 split series

English

- EU – Safety declaration of conformity
- EU – Сигурносћна конформносћна изјава
- EU – Dichiarazione di conformità in materia di sicurezza
- EU – Δήλωση συμμόρφωσης για την ασφάλεια
- EU – Declaración de conformidad relativa a seguridad

- 01 continuation of previous page
- 02 Fortsetzung der vorherigen Seite:
- 03 συνέχεια της παρούσας σελίδας:
- 04 vervolg van vorige pagina:

- 01 Design Specifications of the products to which this declaration relates:
- 02 Konstruktsionnspezifitsatsiien der Produkte, auf die sich diese Erklärung bezieht:
- 03 Specifications of conception des produits auxquels se rapporte cette déclaration:
- 04 Onverspecificaties van de producten waaraan deze verklaring betrekking heeft:
- 05 Especificaciones de diseño de los productos a los cuales hace referencia esta declaración:
- 06 Specifiche di progetto dei prodotti cui fa riferimento la presente dichiarazione:

- 01 • Maximum allowable pressure (PS): <K> (bar)
- Minimum maximum allowable temperature (TS):
- TSmn: Minimum temperature at low pressure side: <L> (°C)
- TSmx: Saturated temperature corresponding with the maximum allowable pressure (PS): <M> (°C)
- Refrigerant: <R>
- Setting of pressure safety device: <P> (bar)
- Manufacturing number and manufacturing year: reër bi modei namperale
- 02 • Maximal zulassung Druck (PS): <K> (bar)
- Minimalmaxima zulassung Temperatur (TS):
- TSmn: Mindesttemperatur auf der Niederdruckseite: <L> (°C)
- TSmx: Sättigungstemperatur bei dem maximal zulässigen Druck (PS): <M> (°C)
- Kühlmittel: <R>
- Einstellung der Druck-Sicherheitsvorrichtung: <P> (bar)
- Herstellungsnr. und Herstellungsjahr: siehe Typenschild des Modells
- 03 • Pression maximale admissible (PS): <K> (bar)
- Température minimum/maximum admissible (TS):
- TSmn: température minimum côté basse pression: <L> (°C)
- TSmx: température saturée correspondant à la pression maximale admissible (PS): <M> (°C)
- Réfrigérant: <R>
- Réglage du dispositif de sécurité de pression: <P> (bar)
- Numéro de fabrication et année de fabrication: se reporter à la petite étiquette du modèle
- 04 • Máxima máxima admisible temperatura (TS):
- TSmn: Minimumtemperatur bei tieferdruckseite: <L> (°C)
- TSmx: Verdampfungs-temperatur die übereinstimmt mit der maximalen boelastbare druck (PS): <M> (°C)
- Kœlmittel: <R>
- Einstellung von druckeichrichtung: <P> (bar)
- Fabrikationsnummer in fabriksjahr: zie naamplaat model
- 05 • Presión máxima admisible (PS): <K> (bar)
- Temperatura mínima/máxima admisible (TS):
- TSmn: Temperatura mínima en el lado de baja presión: <L> (°C)
- TSmx: Temperatura saturada correspondiente a la presión máxima admisible (PS): <M> (°C)
- Refrigerante: <R>
- Ajuste del presostato de seguridad: <P> (bar)
- Número de fabricación y año de fabricación: consulte la placa de especificaciones técnicas de modelo

- 01 Name and address of the Notified body that judged positively on compliance with the Pressure Equipment Directive: <Q>
- 02 Name and address of the barmen Stale, de positt unter Einhaltung der Druckanlagen-Regelina (italie): <Q>
- 03 Nome e address of l'organismo notifié qui a évalué positivement la conformité à la directive sur l'équipement de pression: <Q>
- 04 Naam en adres van de aangewezen instantie die positief geoordeeld heeft over de conformiteit met de Richtlijn Drukapparatuur: <Q>
- 05 Nombre y dirección del Organismo Notificado que juzgó positivamente el cumplimiento con la Directiva en materia de Equipos de Presión: <Q>

- 06 Nome e indirizzo dell'Ente riconosciuta che ha riscontrato la conformità alla Direttiva sulle apparecchiature a pressione: <Q>
- 07 Druha ora bodajbnom tou Κορονητομοτου οργανισμου που στερηοδθη ενταξη για τη συμμόρφωση προς την Οδηγία Εξοπλισμών υπό Πίεση: <Q>
- 08 Nome e morada do organismo notificado, que avalou favoravelmente a conformidade com a diretiva sobre equipamentos pressurizados: <Q>
- 09 Nome e adres organe technického dozoru, prihlaseného k posudzovaniu plneniu obehov v oblasti tlakových zariadení do súhladu s požiadavkami smernice: <Q>

- EU – Smejsvserklaring for sikkerhed
- EU – Туомаллудден valimetusmaksimisusavakuutus
- EU – Везданостно протислен о стодб
- EU – Konformitätsdeklaration für Sicherheit

- 12 continuation of the previous page:
- 13 jatka edelliselle sivulle:
- 14 pokračování z předchozí strany:
- 15 voortzetting van vorige pagina:

- 13 Така ишолува коволев тоуолен намендентивно:
- 14 Specificitasa konstruktsiоvоvоvо, ke kviem se vztahuje toto prohlásení:
- 15 Specificitacia dizajna za proizvod na koje se ova izjava odnosi:
- 16 A jelen nyilatkozat tárgya annak kiegészítő leírásai:
- 17 Specificitacia konstruktsiоvоvоvоvоvо, ktorých dovzyc deklaracia
- 18 Specificitasa de proiectare ale produselor la care se refera aceasta declaratie:
- 19 Specificitatie tehnicazha natra za izdelka, na katere se nanaša ta deklaracija:

- 15 • Najvece dopustitln tlak (PS): <K> (bar)
- Najnižnja dopustna temperatura (TS):
- TSmn: Minimalna temperatura na nizozavnoj strani: <L> (°C)
- TSmx: Saturana temperatura kog odgovara najvećem dopustenom tlaku (PS): <M> (°C)
- Radiator sredstvo: <R>
- Postavke sigurnosne naprave za tlak: <P> (bar)
- Proizvod broj i godina proizvodnje: pogledajte napisnu podjicu modela
- 16 • Legitabelliggiyobb megegerhebb hóméskétt (TS):
- TSmn: Legitabell megegerhebb hóméskétt a kis nyomású oldalon: <L> (°C)
- TSmx: Legitabell megegerhebb nyomásérték a kis nyomású oldalon: <M> (°C)
- TSmn: Minimumtemperatur som motsvarar maximal tillat tryck (PS): <L> (°C)
- TSmx: Maximaltemperatur som motsvarar maximal tillat tryck (PS): <M> (°C)
- Kjølemiddel: <R>
- Innstilling for trycksikkerhetsnett: <P> (bar)
- Tilværingssnummer og tilværingssår: se modellens namplåt
- 17 • Máxima máxima admisible temperatura (TS):
- TSmn: Minimumtemperatur på lavtrykssiden: <L> (°C)
- TSmx: Minimumtemperatur på høytrykssiden: <M> (°C)
- Kjølemiddel: <R>
- Innstilling av sikkerhetsnett for trykk: <P> (bar)
- Produksjonsnummer og produksjonsår: se modellens merkeplate
- 18 • Presiure maxima admisible (PS): <K> (bar)
- Temperatura minima/maxima admisible (TS):
- TSmn: Temperatura minima pe partea de presiune joasa: <L> (°C)
- TSmx: Temperatura maxima pe partea de presiune joasa: <M> (°C)
- Agent frigorifer: <R>
- Regieia dispozitivului de siguranță pentru presiune: <P> (bar)
- Numărul de fabricație și anul de fabricație: consultați placa de identificare a modelului

- 14 Name and address of the notified body, which has positively assessed compliance with the Pressure Equipment Directive: <Q>
- 15 Name and address of the notified body, which has positively assessed compliance with the Pressure Equipment Directive: <Q>
- 16 Name and address of the notified body, which has positively assessed compliance with the Pressure Equipment Directive: <Q>
- 17 Name and address of the notified body, which has positively assessed compliance with the Pressure Equipment Directive: <Q>
- 18 Name and address of the notified body, which has positively assessed compliance with the Pressure Equipment Directive: <Q>

- EC – Декларация о соответствии за безопасност
- ES – Docblbas abilitafbas deklaratsia
- EU – Вышленение о знубе Везданост
- AG – Güvencik uynubuln devayn

- 22 continuation of previous page:
- 23 edimesa eilekijle jng:
- 24 pokračovanie z predchádzajúcej strany:
- 25 onekit isyfadán devayn:

- 20 Toekstnspezifitsatsiynunprouayvnyve, zavotomosnasekvaratsiayna:
- 21 Tolaan nurodvoyos gamliun drazno specificatsiys, su kuriomis susieta ši deklaracija:
- 22 Tolaan nurodvoyos gamliun drazno specificatsiys, su kuriomis susieta ši deklaracija:
- 23 Šis deklaratsias anurov uzstráduko specificatsiys:
- 24 Konstruktivnspezifitsatsiye vnyubovoy, ktorých sa vika toto vyhlásenie:
- 25 Bu byvanin ligli otluygu útrímelenin Tsasmin Üvekilendir:

- 24 • Maximum allowable pressure (PS): <K> (bar)
- Minimum maximum allowable temperature (TS):
- TSmn: Minimumna temperatura na nizozavnoj strani: <L> (°C)
- TSmx: Nasytana temperatura, koi odgovara najvećem dopustenom tlaku (PS): <M> (°C)
- Chladiivo: <R>
- Nastavene tlakoveho pojtsného zarídenia: <P> (bar)
- Výrobné číslo a rok výroby: nájdete na výrobnom štítku modelu
- 25 • Zin verien minimummaksimum sicaklik (TS):
- Zin verien minimummaksimum sicaklik (TS):
- TSmn: Dúskil basing tarafındaki minimum sicaklik: <L> (°C)
- TSmx: Zin verien maksimum basınca (PS) karşı gelen dýma sicaklığı: <M> (°C)
- Söğütücü: <R>
- Basıncı emniyet düzeninin ayarı: <P> (bar)
- İmalat numarası ve imalat yılı: modelin ünite plakasına bakın

- 21 • Maximum allowable pressure (PS): <K> (bar)
- Minimum maximum allowable temperature (TS):
- TSmn: Minimumna temperatura na nizozavnoj strani: <L> (°C)
- TSmx: Nasytana temperatura, koi odgovara najvećem dopustenom tlaku (PS): <M> (°C)
- Chladiivo: <R>
- Nastavene tlakoveho pojtsného zarídenia: <P> (bar)
- Výrobné číslo a rok výroby: nájdete na výrobnom štítku modelu
- 22 • Zin verien minimummaksimum sicaklik (TS):
- Zin verien minimummaksimum sicaklik (TS):
- TSmn: Dúskil basing tarafındaki minimum sicaklik: <L> (°C)
- TSmx: Zin verien maksimum basınca (PS) karşı gelen dýma sicaklığı: <M> (°C)
- Söğütücü: <R>
- Basıncı emniyet düzeninin ayarı: <P> (bar)
- İmalat numarası ve imalat yılı: modelin ünite plakasına bakın

- 21 Name and address of the notified body, which has positively assessed compliance with the Pressure Equipment Directive: <Q>
- 22 Name and address of the notified body, which has positively assessed compliance with the Pressure Equipment Directive: <Q>
- 23 Name and address of the notified body, which has positively assessed compliance with the Pressure Equipment Directive: <Q>
- 24 Name and address of the notified body, which has positively assessed compliance with the Pressure Equipment Directive: <Q>
- 25 Name and address of the notified body, which has positively assessed compliance with the Pressure Equipment Directive: <Q>

UKCA – Safety declaration of conformity

Daikin Europe N.V.

declares under its sole responsibility that the products to which this declaration relates:

RXP50N5V1B, RXP60N5V1B, RXP71N5V1B,

are in conformity with the following directive(s) or regulation(s), provided that the products are used in accordance with our instructions:

- S.I. 2016/1105: Pressure Equipment (Safety) Regulations 2016**
- S.I. 2008/1597: Supply of Machinery (Safety) Regulations 2008***
- S.I. 2016/1101: Electrical Equipment (Safety) Regulations 2016
- S.I. 2016/1091: Electromagnetic Compatibility Regulations 2016*

as amended,

following the provisions of: BS EN 60335-2-40,

* as set out in <A> and judged positively by according to the **Certificate <C>**.

** as set out in the Technical Construction File <D> and judged positively by <E> (Applied module <F>). <G>. Risk category <H>. Also refer to next page.

<A>	DAIKIN.TCF.032E22/09-2022
	—
<C>	—
<D>	DAIKIN.TCF.PED.0632A
<E>	HPI-CEproof Ltd. (NB1521)
<F>	D1
<G>	—
<H>	II

*** Daikin Europe N.V. is authorised to compile the Technical Construction File.



UKCA – Safety declaration of conformity

continuation of previous page:

Design Specifications of the products to which this declaration relates:

Maximum allowable pressure (PS): <K> (bar)

Minimum/maximum allowable temperature (TS*):

* TSmin: Minimum temperature at low pressure side: <L> (°C)

* TSmax: Saturated temperature corresponding with the maximum allowable pressure (PS): <M> (°C)

Refrigerant: <N>

Setting of pressure safety device: <P> (bar)

Manufacturing number and manufacturing year: refer to model nameplate

<K>	PS	41.7 bar
<L>	TSmin	-35 °C
<M>	TSmax	63.8 °C
<N>		R32
<P>		41.7 bar

Name and address of the Notified body that judged positively on compliance with the Pressure Equipment (Safety) Regulations: <Q>

<Q>	HPI-CEproof Ltd. The Manor House Howbery Business Park Wallingford OX10 8BA United Kingdom
-----	---



Table of contents

1	About the documentation	6
1.1	About this document.....	6
2	Specific installer safety instructions	6
3	About the box	8
3.1	Outdoor unit.....	8
3.1.1	To remove the accessories from the outdoor unit.....	8
4	Unit installation	8
4.1	Preparing the installation site.....	8
4.1.1	Installation site requirements of the outdoor unit.....	8
4.1.2	Additional installation site requirements of the outdoor unit in cold climates.....	9
4.2	Mounting the outdoor unit.....	9
4.2.1	To provide the installation structure.....	9
4.2.2	To install the outdoor unit.....	9
4.2.3	To provide drainage.....	9
5	Piping installation	10
5.1	Preparing refrigerant piping.....	10
5.1.1	Refrigerant piping requirements.....	10
5.1.2	Refrigerant piping insulation.....	10
5.1.3	Refrigerant piping length and height difference.....	10
5.2	Connecting the refrigerant piping.....	10
5.2.1	To connect the refrigerant piping to the outdoor unit..	10
5.3	Checking the refrigerant piping.....	11
5.3.1	To check for leaks.....	11
5.3.2	To perform vacuum drying.....	11
6	Charging refrigerant	11
6.1	About the refrigerant.....	11
6.2	To determine the additional refrigerant amount.....	12
6.3	To determine the complete recharge amount.....	12
6.4	To charge additional refrigerant.....	12
6.5	To fix the fluorinated greenhouse gases label.....	12
7	Electrical installation	12
7.1	Specifications of standard wiring components.....	13
7.2	To connect the electrical wiring to the outdoor unit.....	13
8	Finishing the outdoor unit installation	13
8.1	To finish the outdoor unit installation.....	13
9	Commissioning	14
9.1	Checklist before commissioning.....	14
9.2	Checklist during commissioning.....	14
9.3	To perform a test run.....	14
10	Maintenance and service	14
11	Troubleshooting	14
11.1	Fault diagnosis using LED on outdoor unit PCB.....	14
12	Disposal	15
13	Technical data	15
13.1	Wiring diagram.....	15
13.1.1	Unified wiring diagram legend.....	15
13.2	Piping diagram.....	16
13.2.1	Piping diagram: Outdoor unit.....	16

1 About the documentation

1.1 About this document



WARNING

Make sure installation, servicing, maintenance, repair and applied materials follow the instructions from Daikin and, in addition, comply with applicable legislation and are performed by qualified persons only. In Europe and areas where IEC standards apply, EN/IEC 60335-2-40 is the applicable standard.



INFORMATION

Make sure that the user has the printed documentation and ask him/her to keep it for future reference.

Target audience

Authorised installers



INFORMATION

This document only describes installation instructions specific to the outdoor unit. For installation of the indoor unit (mounting the indoor unit, connecting the refrigerant piping to the indoor unit, connecting the electrical wiring to the indoor unit ...), see the installation manual of the indoor unit.

Documentation set

This document is part of a documentation set. The complete set consists of:

- **General safety precautions:**
 - Safety instructions that you **MUST** read before installing
 - Format: Paper (in the box of the outdoor unit)
- **Outdoor unit installation manual:**
 - Installation instructions
 - Format: Paper (in the box of the outdoor unit)
- **Installer reference guide:**
 - Preparation of the installation, reference data, ...
 - Format: Digital files on <https://www.daikin.eu>. Use the search function 🔍 to find your model.

Latest revisions of the supplied documentation may be available on the regional Daikin website or via your dealer.

Scan the QR code below to find the full documentation set and more information about your product on Daikin website.



The original documentation is written in English. All other languages are translations.

Technical engineering data

- A **subset** of the latest technical data is available on the regional Daikin website (publicly accessible).
- The **full set** of latest technical data is available on the Daikin Business Portal (authentication required).

2 Specific installer safety instructions

Always observe the following safety instructions and regulations.

Unit installation (see "4 Unit installation" ▶ 8)



WARNING

Installation shall be done by an installer, the choice of materials and installation shall comply with the applicable legislation. In Europe, EN378 is the applicable standard.

Installation site (see "4.1 Preparing the installation site" ▶ 8)



CAUTION

- Check if the installation location can support the unit's weight. Poor installation is hazardous. It can also cause vibrations or unusual operating noise.
- Provide sufficient service space.
- Do NOT install the unit so that it is in contact with a ceiling or a wall, as this may cause vibrations.

Connecting the refrigerant piping (see "5.2 Connecting the refrigerant piping" ▶ 10)



CAUTION

Piping and joints of a split system shall be made with permanent joints when inside an occupied space except joints directly connecting the piping to the indoor units.



CAUTION

- No brazing or welding on site for units with R32 refrigerant charge during shipment.
- During installation of the refrigeration system, joining of parts with at least one part charged shall be performed taking into account the following requirements: inside occupied spaces non-permanent joints are NOT allowed for R32 refrigerant except for site made joints directly connecting the indoor unit to piping. Site made joints directly connecting piping to indoor units shall be of non-permanent type.



WARNING

Connect the refrigerant piping securely before running the compressor. If the refrigerant piping is NOT connected and the stop valve is open when the compressor is run, air will be sucked in. This will cause abnormal pressure in the refrigeration cycle, which may result in equipment damage and even injury.



CAUTION

- Incomplete flaring may cause refrigerant gas leakage.
- Do NOT re-use flares. Use new flares to prevent refrigerant gas leakage.
- Use flare nuts that are included with the unit. Using different flare nuts may cause refrigerant gas leakage.



CAUTION

Do NOT open the valves before flaring is complete. This would cause refrigerant gas leakage.



DANGER: RISK OF EXPLOSION

Do NOT open the stop valves before the vacuum drying is finished.

Charging refrigerant (see "6 Charging refrigerant" ▶ 11)



WARNING

- The refrigerant inside the unit is mildly flammable, but normally does NOT leak. If the refrigerant leaks in the room and comes in contact with fire from a burner, a heater, or a cooker, this may result in fire, or the formation of a harmful gas.
- Turn OFF any combustible heating devices, ventilate the room, and contact the dealer where you purchased the unit.
- Do NOT use the unit until a service person confirms that the part from which the refrigerant leaked has been repaired.



WARNING

- Only use R32 as refrigerant. Other substances may cause explosions and accidents.
- R32 contains fluorinated greenhouse gases. Its global warming potential (GWP) value is 675. Do NOT vent these gases into the atmosphere.
- When charging refrigerant, ALWAYS use protective gloves and safety glasses.



WARNING

NEVER directly touch any accidental leaking refrigerant. This could result in severe wounds caused by frostbite.

Electrical installation (see "7 Electrical installation" ▶ 12)



WARNING

- All wiring MUST be performed by an authorised electrician and MUST comply with the applicable legislation.
- Make electrical connections to the fixed wiring.
- All components procured on-site and all electrical construction MUST comply with the applicable legislation.



WARNING

- If the power supply has a missing or wrong N-phase, equipment might break down.
- Establish proper earthing. Do NOT earth the unit to a utility pipe, surge absorber, or telephone earth. Incomplete earthing may cause electrical shock.
- Install the required fuses or circuit breakers.
- Secure the electrical wiring with cable ties so that the cables do NOT come in contact with sharp edges or piping, particularly on the high-pressure side.
- Do NOT use taped wires, stranded conductor wires, extension cords, or connections from a star system. They can cause overheating, electrical shock or fire.
- Do NOT install a phase advancing capacitor, because this unit is equipped with an inverter. A phase advancing capacitor will reduce performance and may cause accidents.



WARNING

ALWAYS use multicore cable for power supply cables.



WARNING

Use an all-pole disconnection type breaker with at least 3 mm between the contact point gaps that provides full disconnection under overvoltage category III.

3 About the box

WARNING

If the supply cord is damaged, it **MUST** be replaced by the manufacturer, its service agent or similarly qualified persons in order to avoid a hazard.

WARNING

Do **NOT** connect the power supply to the indoor unit. This could result in electrical shock or fire.

WARNING

- Do **NOT** use locally purchased electrical parts inside the product.
- Do **NOT** branch the power supply for the drain pump, etc. from the terminal block. This could result in electrical shock or fire.

WARNING

Keep the interconnection wiring away from copper pipes without thermal insulation as such pipes will be very hot.

DANGER: RISK OF ELECTROCUTION

All electrical parts (including thermistors) are powered by the power supply. Do **NOT** touch them with bare hands.

DANGER: RISK OF ELECTROCUTION

Disconnect the power supply for more than 10 minutes, and measure the voltage at the terminals of main circuit capacitors or electrical components before servicing. The voltage **MUST** be less than 50 V DC before you can touch electrical components. For the location of the terminals, see the wiring diagram.

Finishing indoor unit installation (see "8 Finishing the outdoor unit installation" [p 13])

DANGER: RISK OF ELECTROCUTION

- Make sure that the system is earthed properly.
- Turn **OFF** the power supply before servicing.
- Install the switch box cover before turning **ON** the power supply.

Commissioning (see "9 Commissioning" [p 14])

DANGER: RISK OF ELECTROCUTION

DANGER: RISK OF BURNING/SCALDING

CAUTION

Do **NOT** perform the test operation while working on the indoor units.

When performing the test operation, **NOT ONLY** the outdoor unit, but the connected indoor unit will operate as well. Working on an indoor unit while performing a test operation is dangerous.


CAUTION

Do **NOT** insert fingers, rods or other objects into the air inlet or outlet. Do **NOT** remove the fan guard. When the fan is rotating at high speed, it will cause injury.

3 About the box

3.1 Outdoor unit

3.1.1 To remove the accessories from the outdoor unit

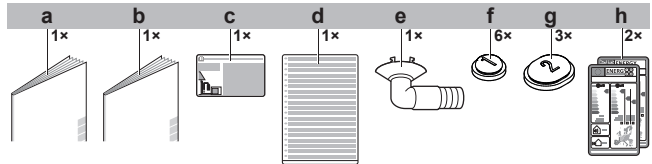

- a General safety precautions
- b Outdoor unit installation manual
- c Fluorinated greenhouse gases label
- d Multilingual fluorinated greenhouse gases label
- e Drain plug (located on the bottom of the packing case)
- f Drain cap (1)
- g Drain cap (2)
- h Energy label

4 Unit installation


WARNING

Installation shall be done by an installer, the choice of materials and installation shall comply with the applicable legislation. In Europe, EN378 is the applicable standard.

4.1 Preparing the installation site

4.1.1 Installation site requirements of the outdoor unit

Mind the following spacing guidelines:

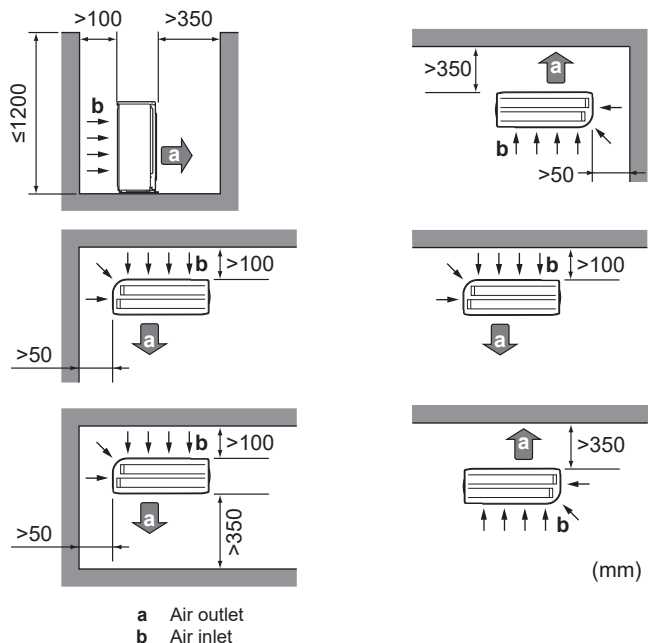

NOTICE

The height of the wall on the outlet side of the outdoor unit **MUST** be ≤ 1200 mm.

Do **NOT** install the unit in sound sensitive areas (e.g. near a bedroom), so that the operation noise will cause no trouble.

Note: If the sound is measured under actual installation conditions, the measured value might be higher than the sound pressure level mentioned in "Sound spectrum" in the data book due to environmental noise and sound reflections.

i INFORMATION


The sound pressure level is less than 70 dBA.

The outdoor unit is designed for outdoor installation only and for ambient temperatures specified in the table below (unless otherwise specified in the operation manual of the connected indoor unit).

Cooling	Heating
-10~48°C DB	-15~24°C DB

4.1.2 Additional installation site requirements of the outdoor unit in cold climates

Protect the outdoor unit against direct snowfall and take care that the outdoor unit is NEVER snowed up.

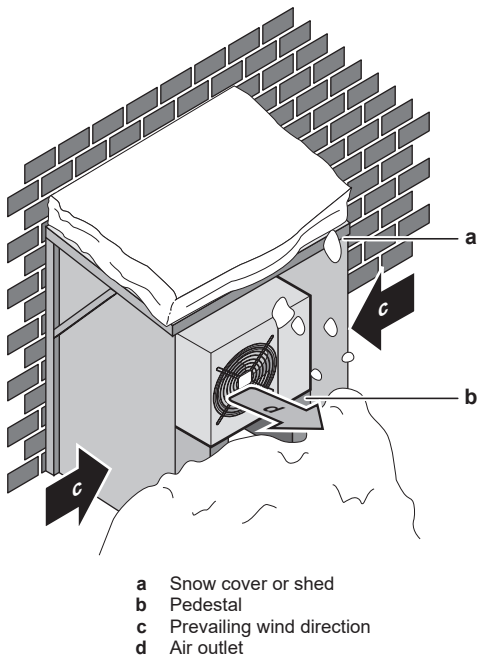

- a Snow cover or shed
- b Pedestal
- c Prevailing wind direction
- d Air outlet

It is recommended to provide at least 150 mm of free space below the unit (300 mm for heavy snowfall areas). Additionally, make sure the unit is positioned at least 100 mm above the maximum expected level of snow. If necessary, construct a pedestal. See "4.2 Mounting the outdoor unit" [p. 9] for more details.



In heavy snowfall areas it is very important to select an installation site where the snow will NOT affect the unit. If lateral snowfall is possible, make sure that the heat exchanger coil is NOT affected by the snow. If necessary, install a snow cover or shed and a pedestal.

4.2 Mounting the outdoor unit

4.2.1 To provide the installation structure


Use a vibration-proof rubber (field supply) in cases where vibrations may be transmitted to the building.

Prepare 4 sets of M8 or M10 anchor bolts, nuts and washers (field supply).

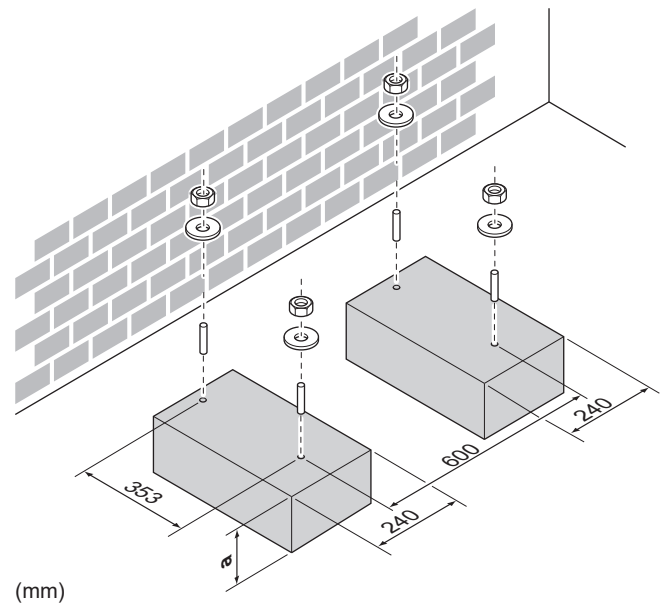

a 100 mm above expected level of snow

4.2.2 To install the outdoor unit

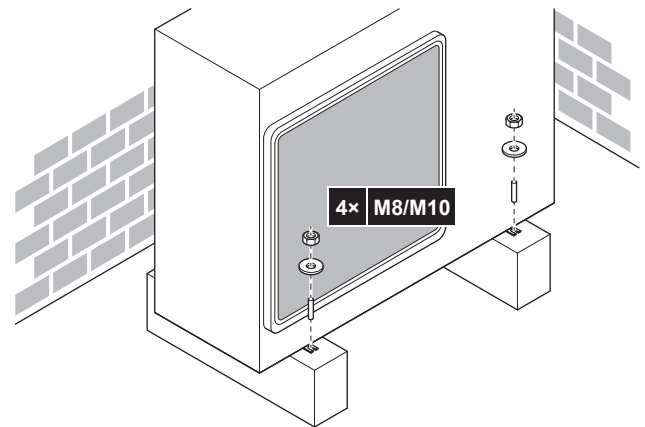

4.2.3 To provide drainage



NOTICE

If the unit is installed in a cold climate, take adequate measures so that the evacuated condensate CANNOT freeze.



NOTICE


If the drain holes of the outdoor unit are blocked up by a mounting base or floor surface, place additional foot bases ≤30 mm under the outdoor unit's feet.



INFORMATION

For information on the available options, contact your dealer.

- 1 Use a drain plug for drainage.
- 2 Use a Ø16 mm hose (field supply).

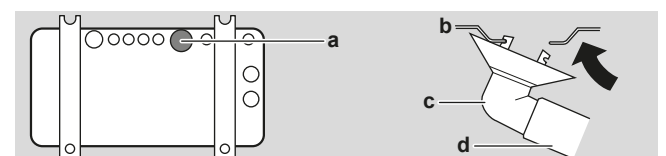

- a Drain port
- b Bottom frame

5 Piping installation

- c Drain plug
- d Hose (field supply)


^(a) Depending on the applicable legislation and the maximum working pressure of the unit (see "PS High" on the unit name plate), larger piping thickness might be required.

To close the drain holes and attach the drain socket

NOTICE


In cold areas, do NOT use a drain socket, hose and caps (1, 2) with the outdoor unit. Take adequate measures so that the evacuated condensate CANNOT freeze.

- 1 Install drain caps 1 and 2 (accessory). Make sure the edges of the drain caps close off the holes completely.



- a Bottom frame
- b Drain cap

- 2 Install the drain socket.



- a Drain hole. Install a drain cap (2).
- b Drain hole. Install a drain cap (1).
- c Drain hole for drain socket

5 Piping installation

5.1 Preparing refrigerant piping

5.1.1 Refrigerant piping requirements

CAUTION

Piping and joints of a split system shall be made with permanent joints when inside an occupied space except joints directly connecting the piping to the indoor units.

NOTICE

The piping and other pressure-containing parts shall be suitable for refrigerant. Use phosphoric acid deoxidised seamless copper for refrigerant piping.

- Foreign materials inside pipes (including oils for fabrication) must be ≤ 30 mg/10 m.

Refrigerant piping diameter

Use the same diameters as the connections on the outdoor units:

Pipe outer diameter (mm)	
Liquid piping	Gas piping
Ø6.4	Ø12.7

Refrigerant piping material

- Piping material:** phosphoric acid deoxidised seamless copper
- Flare connections:** Only use annealed material.
- Piping temper grade and thickness:**

Outer diameter (Ø)	Temper grade	Thickness (t) ^(a)	
6.4 mm (1/4")	Annealed (O)	≥ 0.8 mm	
12.7 mm (1/2")			

5.1.2 Refrigerant piping insulation

- Use polyethylene foam as insulation material:
 - with a heat transfer rate between 0.041 and 0.052 W/mK (0.035 and 0.045 kcal/mh°C)
 - with a heat resistance of at least 120°C
- Insulation thickness

Pipe outer diameter (Ø _p)	Insulation inner diameter (Ø _i)	Insulation thickness (t)
6.4 mm (1/4")	8~10 mm	≥ 10 mm
12.7 mm (1/2")	14~16 mm	≥ 13 mm



If the temperature is higher than 30°C and the humidity is higher than RH 80%, the thickness of the insulation materials should be at least 20 mm to prevent condensation on the surface of the insulation.

5.1.3 Refrigerant piping length and height difference

What?	Distance
Maximum allowable pipe length	30 m
Minimum allowable pipe length	3 m
Maximum allowable height distance	20 m

5.2 Connecting the refrigerant piping



DANGER: RISK OF BURNING/SCALDING



CAUTION

- No brazing or welding on site for units with R32 refrigerant charge during shipment.
- During installation of the refrigeration system, joining of parts with at least one part charged shall be performed taking into account the following requirements: inside occupied spaces non-permanent joints are NOT allowed for R32 refrigerant except for site made joints directly connecting the indoor unit to piping. Site made joints directly connecting piping to indoor units shall be of non-permanent type.

5.2.1 To connect the refrigerant piping to the outdoor unit

- Piping length.** Keep field piping as short as possible.
- Piping protection.** Protect the field piping against physical damage.




WARNING

Connect the refrigerant piping securely before running the compressor. If the refrigerant piping is NOT connected and the stop valve is open when the compressor is run, air will be sucked in. This will cause abnormal pressure in the refrigeration cycle, which may result in equipment damage and even injury.

NOTICE

- Use the flare nut fixed to the unit.
- To prevent gas leakage, apply refrigeration oil **ONLY** to the inside of the flare. Use refrigeration oil for R32 (FW68DA).
- Do **NOT** reuse joints.

- Connect the liquid refrigerant connection from the indoor unit to the liquid stop valve of the outdoor unit.



- a Liquid stop valve
- b Gas stop valve
- c Service port

- Connect the gas refrigerant connection from the indoor unit to the gas stop valve of the outdoor unit.

NOTICE

It is recommended that the refrigerant piping between indoor and outdoor unit is installed in a ducting or the refrigerant piping is wrapped with finishing tape.

5.3 Checking the refrigerant piping

5.3.1 To check for leaks

NOTICE

Do **NOT** exceed the unit's maximum working pressure (see "PS High" on the unit name plate).

NOTICE

ALWAYS use a recommended bubble test solution from your wholesaler.

NEVER use soap water:

- Soap water may cause cracking of components, such as flare nuts or stop valve caps.
- Soap water may contain salt, which absorbs moisture that will freeze when the piping gets cold.
- Soap water contains ammonia which may lead to corrosion of flared joints (between the brass flare nut and the copper flare).

- Charge the system with nitrogen gas up to a gauge pressure of at least 200 kPa (2 bar). It is recommended to pressurize to 3000 kPa (30 bar) in order to detect small leaks.
- Check for leaks by applying the bubble test solution to all connections.
- Discharge all nitrogen gas.

5.3.2 To perform vacuum drying



DANGER: RISK OF EXPLOSION

Do **NOT** open the stop valves before the vacuum drying is finished.

- Vacuum the system until the pressure on the manifold indicates -0.1 MPa (-1 bar).
- Leave as is for 4-5 minutes and check the pressure:

If the pressure...	Then...
Does not change	There is no moisture in the system. This procedure is finished.
Increases	There is moisture in the system. Go to the next step.

- Vacuum the system for at least 2 hours to a manifold pressure of -0.1 MPa (-1 bar).
- After turning the pump OFF, check the pressure for at least 1 hour.
- If you do **NOT** reach the target vacuum or **CANNOT** maintain the vacuum for 1 hour, do the following:
 - Check for leaks again.
 - Perform vacuum drying again.



NOTICE

Make sure to open the stop valves after installing the refrigerant piping and performing vacuum drying. Running the system with the stop valves closed may break the compressor.

6 Charging refrigerant

6.1 About the refrigerant

This product contains fluorinated greenhouse gases. Do **NOT** vent gases into the atmosphere.

Refrigerant type: R32

Global warming potential (GWP) value: 675

Periodical inspections for refrigerant leaks may be required depending on the applicable legislation. Contact your installer for more information.



WARNING: MILDLY FLAMMABLE MATERIAL

The refrigerant inside this unit is mildly flammable.



WARNING

- The refrigerant inside the unit is mildly flammable, but normally does **NOT** leak. If the refrigerant leaks in the room and comes in contact with fire from a burner, a heater, or a cooker, this may result in fire, or the formation of a harmful gas.
- Turn **OFF** any combustible heating devices, ventilate the room, and contact the dealer where you purchased the unit.
- Do **NOT** use the unit until a service person confirms that the part from which the refrigerant leaked has been repaired.



WARNING

- Do **NOT** pierce or burn refrigerant cycle parts.
- Do **NOT** use cleaning materials or means to accelerate the defrosting process other than those recommended by the manufacturer.
- Be aware that the refrigerant inside the system is odourless.



WARNING

NEVER directly touch any accidental leaking refrigerant. This could result in severe wounds caused by frostbite.

7 Electrical installation

6.2 To determine the additional refrigerant amount

If the total liquid piping length is...	Then...
≤10 m	Do NOT add additional refrigerant.
>10 m	R=(total length (m) of liquid piping-10 m)×0.020 R=Additional charge (kg) (rounded in units of 0.01 kg)



INFORMATION

Piping length is the one-way length of liquid piping.

6.3 To determine the complete recharge amount



INFORMATION

If a complete recharge is necessary, the total refrigerant charge is: the factory refrigerant charge (see unit name plate) + the determined additional amount.

6.4 To charge additional refrigerant



WARNING


- Only use R32 as refrigerant. Other substances may cause explosions and accidents.
- R32 contains fluorinated greenhouse gases. Its global warming potential (GWP) value is 675. Do NOT vent these gases into the atmosphere.
- When charging refrigerant, ALWAYS use protective gloves and safety glasses.

Prerequisite: Before charging refrigerant, make sure the refrigerant piping is connected and checked (leak test and vacuum drying).

- Connect the refrigerant cylinder to the service port.
- Charge the additional refrigerant amount.
- Open the gas stop valve.

6.5 To fix the fluorinated greenhouse gases label

- Fill in the label as follows:

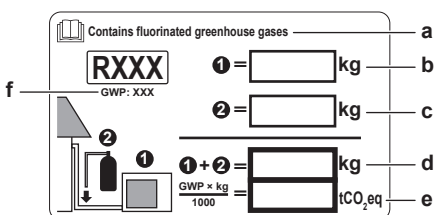

- If a multilingual fluorinated greenhouse gases label is delivered with the unit (see accessories), peel off the applicable language and stick it on top of a.
- Factory refrigerant charge: see unit name plate
- Additional refrigerant amount charged
- Total refrigerant charge
- Quantity of fluorinated greenhouse gases** of the total refrigerant charge expressed as tonnes CO₂ equivalent.
- GWP = Global warming potential



NOTICE

Applicable legislation on **fluorinated greenhouse gases** requires that the refrigerant charge of the unit is indicated both in weight and CO₂ equivalent.

Formula to calculate the quantity in CO₂ equivalent tonnes: GWP value of the refrigerant × total refrigerant charge [in kg] / 1000

Use the GWP value mentioned on the refrigerant charge label.

- Fix the label on the inside of the outdoor unit near the gas and liquid stop valves.

7 Electrical installation



DANGER: RISK OF ELECTROCUTION



WARNING

- All wiring MUST be performed by an authorised electrician and MUST comply with the applicable legislation.
- Make electrical connections to the fixed wiring.
- All components procured on-site and all electrical construction MUST comply with the applicable legislation.



WARNING

The appliance MUST be installed in accordance with national wiring regulations.



WARNING

ALWAYS use multicore cable for power supply cables.



WARNING

Use an all-pole disconnection type breaker with at least 3 mm between the contact point gaps that provides full disconnection under overvoltage category III.



WARNING

If the supply cord is damaged, it MUST be replaced by the manufacturer, its service agent or similarly qualified persons in order to avoid a hazard.



WARNING

Do NOT connect the power supply to the indoor unit. This could result in electrical shock or fire.



WARNING

- Do NOT use locally purchased electrical parts inside the product.
- Do NOT branch the power supply for the drain pump, etc. from the terminal block. This could result in electrical shock or fire.



WARNING

Keep the interconnection wiring away from copper pipes without thermal insulation as such pipes will be very hot.



DANGER: RISK OF ELECTROCUTION


All electrical parts (including thermistors) are powered by the power supply. Do NOT touch them with bare hands.

8 Finishing the outdoor unit installation



DANGER: RISK OF ELECTROCUTION

Disconnect the power supply for more than 10 minutes, and measure the voltage at the terminals of main circuit capacitors or electrical components before servicing. The voltage **MUST** be less than 50 V DC before you can touch electrical components. For the location of the terminals, see the wiring diagram.

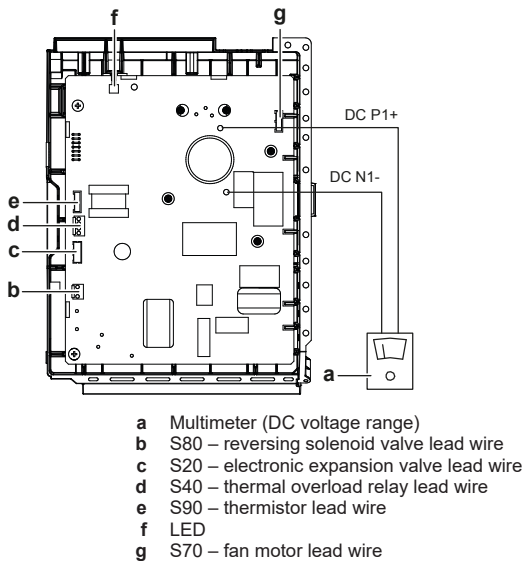


7.1 Specifications of standard wiring components

Component		
Power supply cable	Voltage	220~240 V
	Phase	1~
	Frequency	50 Hz
	Wire sizes	3-core cable 2.5 mm ^{2(a)} / 4.0 mm ^{2(b)} (^a)H05RN-F (60245 IEC 57) (^b)H07RN-F (60245 IEC 66)
Interconnection cable (indoor↔outdoor)	4-core cable 1.5 mm ² ~2.5 mm ² and applicable for 220~240 V H05RN-F (60245 IEC 57)	
Recommended circuit breaker	20 A(^a)	
Earth leakage circuit breaker	MUST comply with applicable legislation	


(^a) Electrical equipment complying with EN/IEC 61000-3-12 (European/International Technical Standard setting the limits for harmonic currents produced by equipment connected to public low-voltage systems with input current >16 A and ≤75 A per phase).

7.2 To connect the electrical wiring to the outdoor unit

- 1 Remove the service cover.
- 2 Remove the switch box cover.
- 3 Open the wire clamp.
- 4 Connect the interconnection cable and power supply as follows:

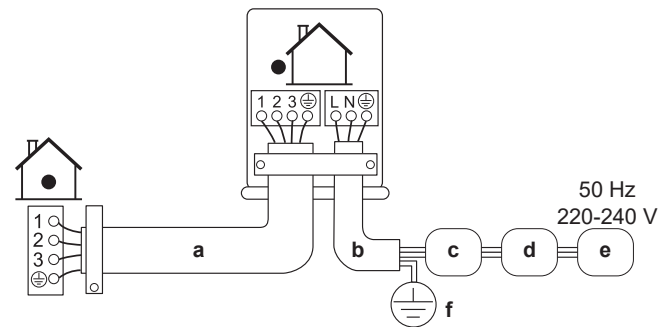

- a Interconnection cable
 b Power supply cable
 c Circuit breaker
 d Residual current device
 e Power supply
 f Earth

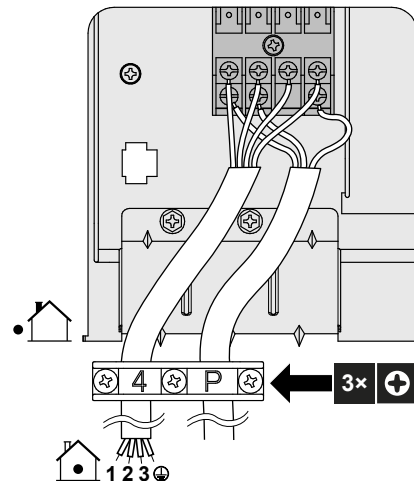

- 5 Tighten the terminal screws securely. We recommend using a Phillips screwdriver.
- 6 Install the service cover.
- 7 Install the switch box cover.

8 Finishing the outdoor unit installation


8.1 To finish the outdoor unit installation



DANGER: RISK OF ELECTROCUTION

- Make sure that the system is earthed properly.
- Turn OFF the power supply before servicing.
- Install the switch box cover before turning ON the power supply.

- 1 Insulate and fix the refrigerant piping and cables as follows:

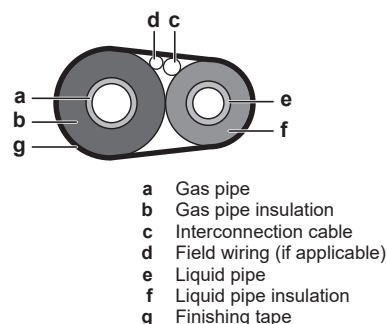

9 Commissioning

- 2 Install the service cover.

9 Commissioning



NOTICE

General commissioning checklist. Next to the commissioning instructions in this chapter, a general commissioning checklist is also available on the Daikin Business Portal (authentication required).

The general commissioning checklist is complementary to the instructions in this chapter and can be used as a guideline and reporting template during commissioning and hand-over to the user.



NOTICE

ALWAYS operate the unit with thermistors and/or pressure sensors/switches. If NOT, burning of the compressor might be the result.

9.1 Checklist before commissioning

- 1 After the installation of the unit, check the items listed below.
- 2 Close the unit.
- 3 Power up the unit.

<input type="checkbox"/>	The indoor unit is properly mounted.
<input type="checkbox"/>	The outdoor unit is properly mounted.
<input type="checkbox"/>	The system is properly earthed and the earth terminals are tightened.
<input type="checkbox"/>	The power supply voltage matches the voltage on the identification label of the unit.
<input type="checkbox"/>	There are NO loose connections or damaged electrical components in the switch box.
<input type="checkbox"/>	There are NO damaged components or squeezed pipes on the inside of the indoor and outdoor units.
<input type="checkbox"/>	There are NO refrigerant leaks .
<input type="checkbox"/>	The refrigerant pipes (gas and liquid) are thermally insulated.
<input type="checkbox"/>	The correct pipe size is installed and the pipes are properly insulated.
<input type="checkbox"/>	The stop valves (gas and liquid) on the outdoor unit are fully open.
<input type="checkbox"/>	The following field wiring has been carried out according to this document and the applicable legislation between the outdoor unit and the indoor unit.
<input type="checkbox"/>	Drainage Make sure drainage flows smoothly. Possible consequence: Condensate water might drip.
<input type="checkbox"/>	The indoor unit receives the signals of the user interface .
<input type="checkbox"/>	The specified wires are used for the interconnection cable .
<input type="checkbox"/>	The fuses, circuit breakers , or locally installed protection devices are installed according to this document, and have NOT been bypassed.

9.2 Checklist during commissioning

<input type="checkbox"/>	To perform an air purge .
--------------------------	----------------------------------

<input type="checkbox"/>	To perform a test run .
--------------------------	--------------------------------

9.3 To perform a test run

Prerequisite: Power supply MUST be in the specified range.

Prerequisite: Test run may be performed in cooling or heating mode.

Prerequisite: Test run should be performed in accordance with the operation manual of the indoor unit to make sure that all functions and parts are working properly.

- 1 In cooling mode, select the lowest programmable temperature. In heating mode, select the highest programmable temperature. Test run can be disabled if necessary.
- 2 When the test run is finished, set the temperature to a normal level. In cooling mode: 26~28°C, in heating mode: 20~24°C.
- 3 The system stops operating 3 minutes after the unit is turned OFF.



INFORMATION

- Even if the unit is turned OFF, it consumes electricity.
- When the power turns back on after a power break, the previously selected mode will be resumed.

10 Maintenance and service



NOTICE

General maintenance/inspection checklist. Next to the maintenance instructions in this chapter, a general maintenance/inspection checklist is also available on the Daikin Business Portal (authentication required).

The general maintenance/inspection checklist is complementary to the instructions in this chapter and can be used as a guideline and reporting template during maintenance.



NOTICE

Maintenance MUST be done by an authorised installer or service agent.

We recommend performing maintenance at least once a year. However, applicable legislation might require shorter maintenance intervals.



NOTICE



Applicable legislation on **fluorinated greenhouse gases** requires that the refrigerant charge of the unit is indicated both in weight and CO₂ equivalent.

Formula to calculate the quantity in CO₂ equivalent tonnes: GWP value of the refrigerant × total refrigerant charge [in kg] / 1000

11 Troubleshooting

11.1 Fault diagnosis using LED on outdoor unit PCB

LED is...	Diagnosis	
	flashing	Normal. ▪ Check the indoor unit.

LED is...	Diagnosis
 ON	<ul style="list-style-type: none"> Turn the power OFF and back ON, and check the LED within approximately 3 minutes. If the LED is ON again, the outdoor unit PCB is faulty.
 OFF	<ol style="list-style-type: none"> Supply voltage (for power saving). Power supply fault. Turn the power OFF and back ON, and check the LED within approximately 3 minutes. <p>If the LED is OFF again, the outdoor unit PCB is faulty.</p>

**DANGER: RISK OF ELECTROCUTION**

- When the unit is NOT operating, the LEDs on the PCB are turned OFF in order to save power.
- Even when the LEDs are OFF, the terminal block and the PCB may be powered.

12 Disposal

**NOTICE**

Do NOT try to dismantle the system yourself: dismantling of the system, treatment of the refrigerant, oil and other parts MUST comply with applicable legislation. Units MUST be treated at a specialised treatment facility for reuse, recycling and recovery.

**INFORMATION**

To protect the environment, make sure to perform an automatic pump down operation when relocating or dismantling the unit. For the pump down procedure, refer to the service manual or the installer reference guide.

13 Technical data











- A **subset** of the latest technical data is available on the regional Daikin website (publicly accessible).
- The **full set** of latest technical data is available on the Daikin Business Portal (authentication required).










13.1 Wiring diagram

The wiring diagram is delivered with the unit, located inside of the outdoor unit (bottom side of the top plate).

13.1.1 Unified wiring diagram legend

For applied parts and numbering, refer to the wiring diagram on the unit. Part numbering is by Arabic numbers in ascending order for each part and is represented in the overview below by "*" in the part code.

Symbol	Meaning	Symbol	Meaning
	Circuit breaker		Protective earth
			
	Connection		Protective earth (screw)
	Connector		Rectifier
	Earth		Relay connector

Symbol	Meaning	Symbol	Meaning
	Field wiring		Short-circuit connector
	Fuse		Terminal
	Indoor unit		Terminal strip
	Outdoor unit		Wire clamp
	Residual current device		

Symbol	Colour	Symbol	Colour
BLK	Black	ORG	Orange
BLU	Blue	PNK	Pink
BRN	Brown	PRP, PPL	Purple
GRN	Green	RED	Red
GRY	Grey	WHT	White
SKY BLU	Sky blue	YLW	Yellow

Symbol	Meaning
A*P	Printed circuit board
BS*	Pushbutton ON/OFF, operation switch
BZ, H*O	Buzzer
C*	Capacitor
AC*, CN*, E*, HA*, HE*, HL*, HN*, HR*, MR*_A, MR*_B, S*, U, V, W, X*A, K*R_*, NE	Connection, connector
D*, V*D	Diode
DB*	Diode bridge
DS*	DIP switch
E*H	Heater
FU*, F*U, (for characteristics, refer to PCB inside your unit)	Fuse
FG*	Connector (frame ground)
H*	Harness
H*P, LED*, V*L	Pilot lamp, light emitting diode
HAP	Light emitting diode (service monitor green)
HIGH VOLTAGE	High voltage
IES	Intelligent eye sensor
IPM*	Intelligent power module
K*R, KCR, KFR, KHuR, K*M	Magnetic relay
L	Live
L*	Coil
L*R	Reactor
M*	Stepper motor
M*C	Compressor motor
M*F	Fan motor
M*P	Drain pump motor
M*S	Swing motor
MR*, MRCW*, MRM*, MRN*	Magnetic relay
N	Neutral
n=*, N=*	Number of passes through ferrite core
PAM	Pulse-amplitude modulation
PCB*	Printed circuit board
PM*	Power module
PS	Switching power supply

13 Technical data

Symbol	Meaning
PTC*	PTC thermistor
Q*	Insulated gate bipolar transistor (IGBT)
Q*C	Circuit breaker
Q*DI, KLM	Earth leak circuit breaker
Q*L	Overload protector
Q*M	Thermo switch
Q*R	Residual current device
R*	Resistor
R*T	Thermistor
RC	Receiver
S*C	Limit switch
S*L	Float switch
S*NG	Refrigerant leak detector
S*NPH	Pressure sensor (high)
S*NPL	Pressure sensor (low)
S*PH, HPS*	Pressure switch (high)
S*PL	Pressure switch (low)
S*T	Thermostat

Symbol	Meaning
S*RH	Humidity sensor
S*W, SW*	Operation switch
SA*, F1S	Surge arrester
SR*, WLU	Signal receiver
SS*	Selector switch
SHEET METAL	Terminal strip fixed plate
T*R	Transformer
TC, TRC	Transmitter
V*, R*V	Varistor
V*R	Diode bridge, Insulated-gate bipolar transistor (IGBT) power module
WRC	Wireless remote controller
X*	Terminal
X*M	Terminal strip (block)
Y*E	Electronic expansion valve coil
Y*R, Y*S	Reversing solenoid valve coil
Z*C	Ferrite core
ZF, Z*F	Noise filter


13.2 Piping diagram

13.2.1 Piping diagram: Outdoor unit

PED categories of equipment:

- High pressure switch: category IV,
- Compressor: category II;
- Other equipment: art. 4§3.


RXP50N

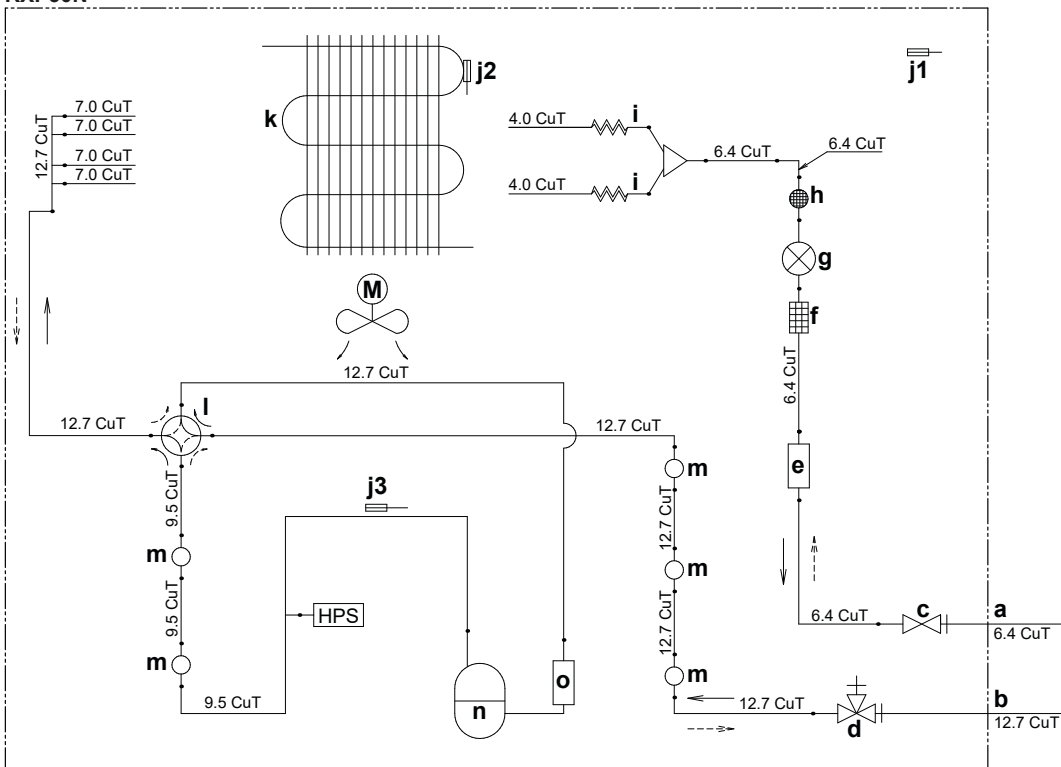

- | | | | |
|----|--------------------------------|-----|--|
| a | Liquid field piping | j3 | Discharge pipe thermistor |
| b | Gas field piping | k | Heat exchanger |
| c | Liquid stop valve | l | 4-way valve (ON: heating) |
| d | Gas stop valve | m | Muffler |
| e | Liquid receiver | n | Compressor |
| f | Filter | o | Accumulator |
| g | Electronic expansion valve | HPS | High pressure switch (automatic reset) |
| h | Muffler with filter | M | Propeller fan |
| i | Capillary tube | | |
| j1 | Outdoor temperature thermistor | | |
- Refrigerant flow: cooling
 - - - - - Refrigerant flow: heating

j2 Heat exchanger thermistor

RXP60N, RXP71N

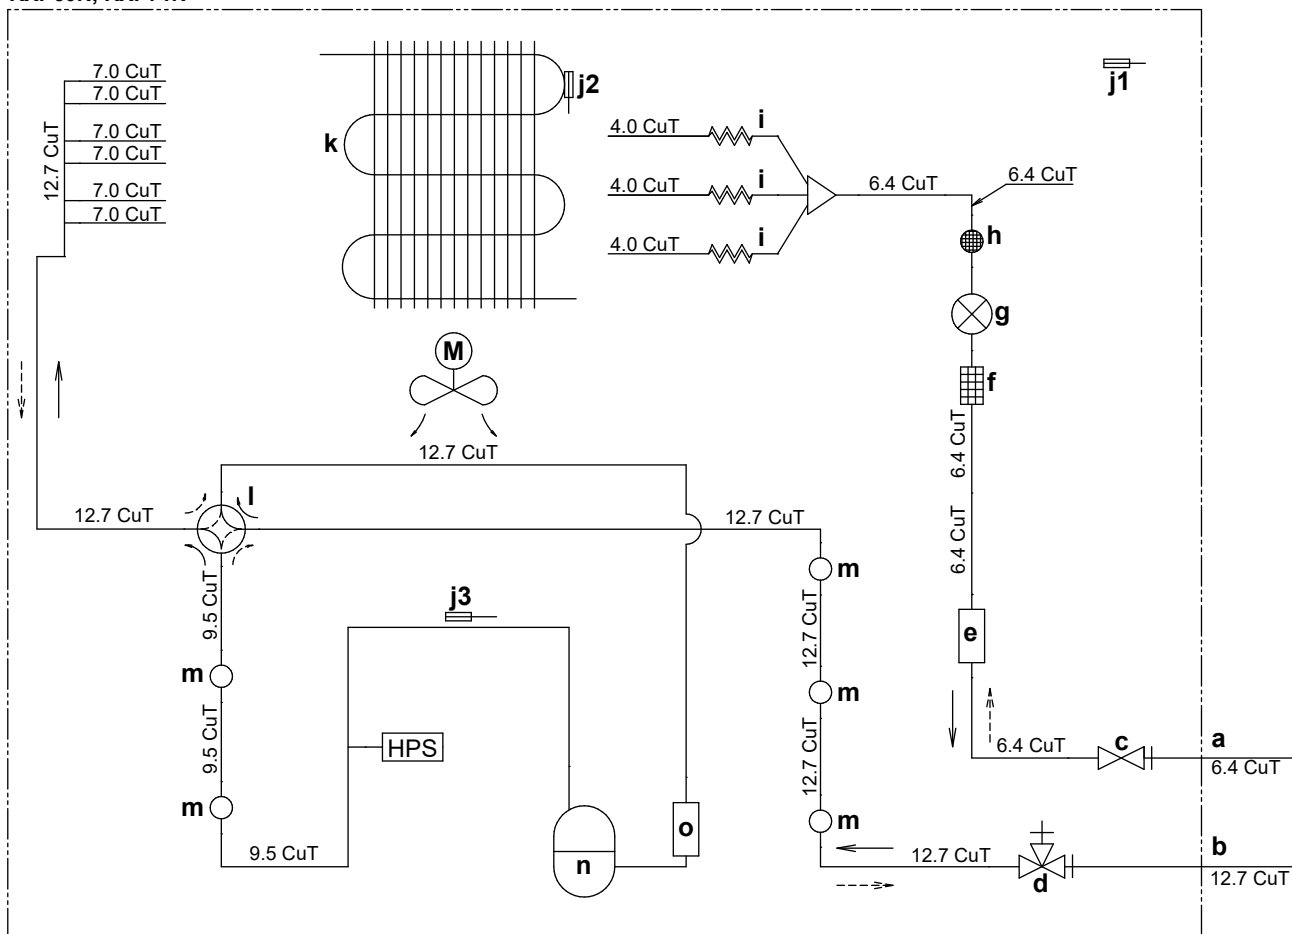

- a Liquid field piping
 - b Gas field piping
 - c Liquid stop valve
 - d Gas stop valve
 - e Liquid receiver
 - f Filter
 - g Electronic expansion valve
 - h Muffler with filter
 - i Capillary tube
 - j1 Outdoor temperature thermistor
 - j2 Heat exchanger thermistor
 - j3 Discharge pipe thermistor
 - k Heat exchanger
 - l 4-way valve (ON: heating)
 - m Muffler
 - n Compressor
 - o Accumulator
 - HPS High pressure switch (automatic reset)
 - M Propeller fan
- > Refrigerant flow: cooling
 - - -> Refrigerant flow: heating





ERC



DAIKIN ISITMA VE SOĞUTMA SİSTEMLERİ SAN.TİC. A.Ş.

Gülsuyu Mahallesi, Fevzi Çakmak Caddesi, Burçak Sokak, No:20, 34848 Maltepe

İSTANBUL / TÜRKİYE

Tel: 0216 453 27 00

Faks: 0216 671 06 00

Çağrı Merkezi: 444 999 0

Web: www.daikin.com.tr

DAIKIN EUROPE N.V.

Zandvoordestraat 300, B-8400 Oostende, Belgium

3P645642-4G 2022.06

Copyright 2022 Daikin